



213-222
577.581
A-98
ALCOO COOP
E-2 4/29/81

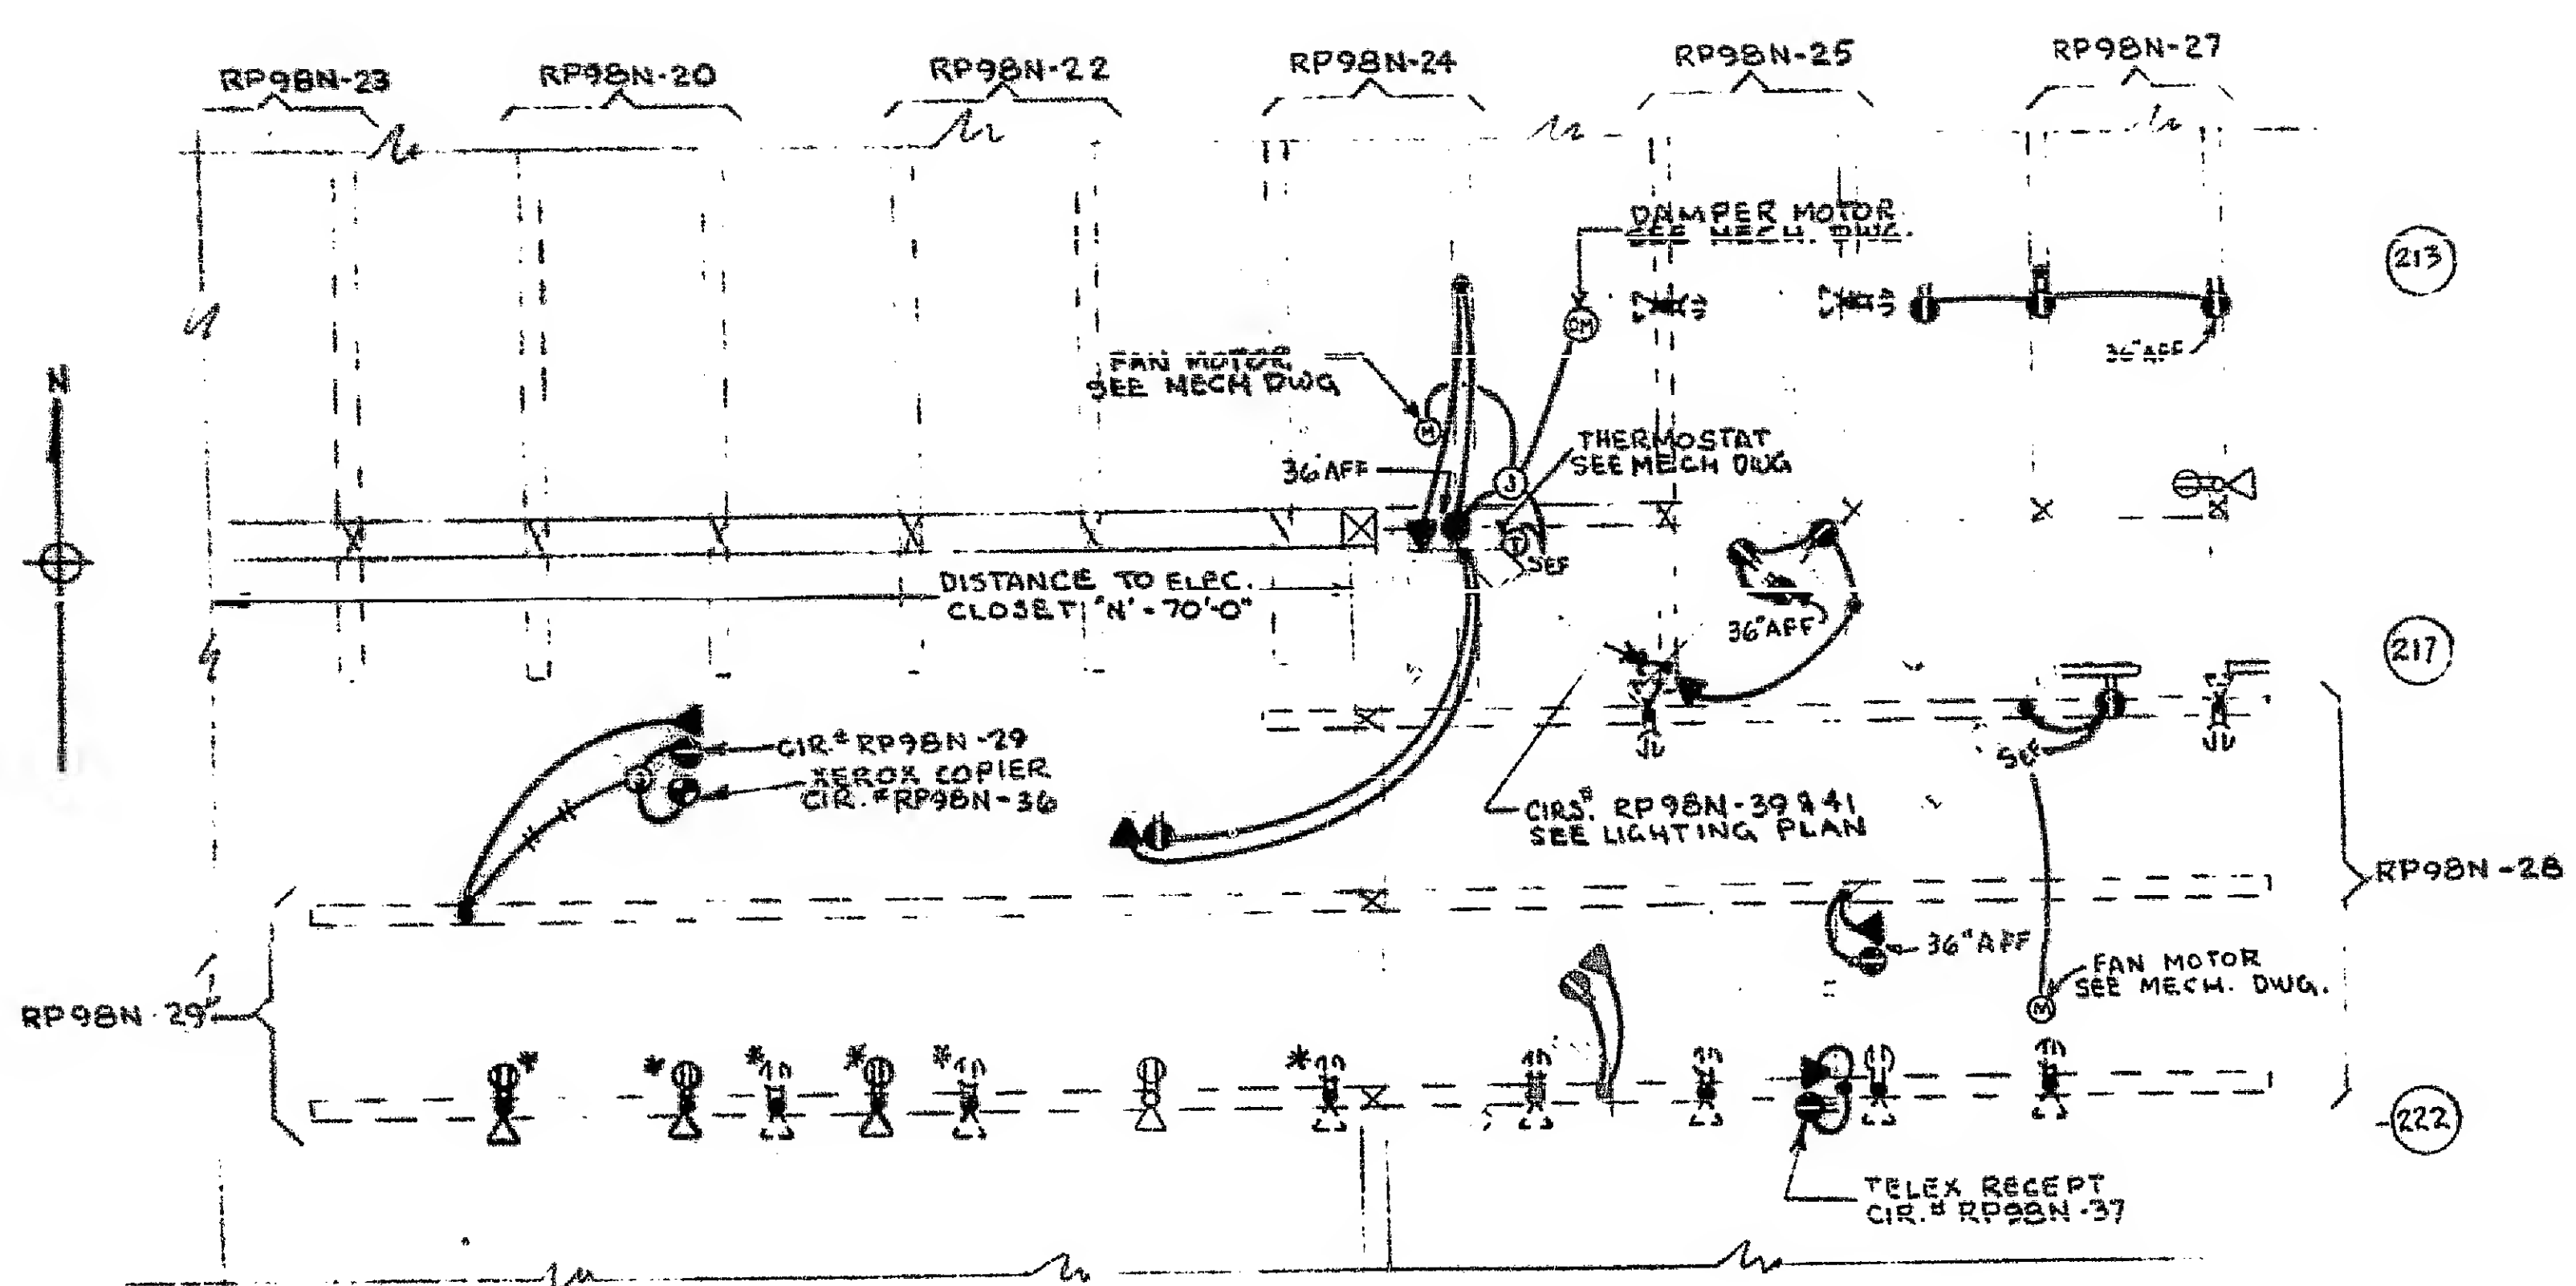

POWER & TELEPHONE PLAN
SCALE 1/8" = 1'-0"

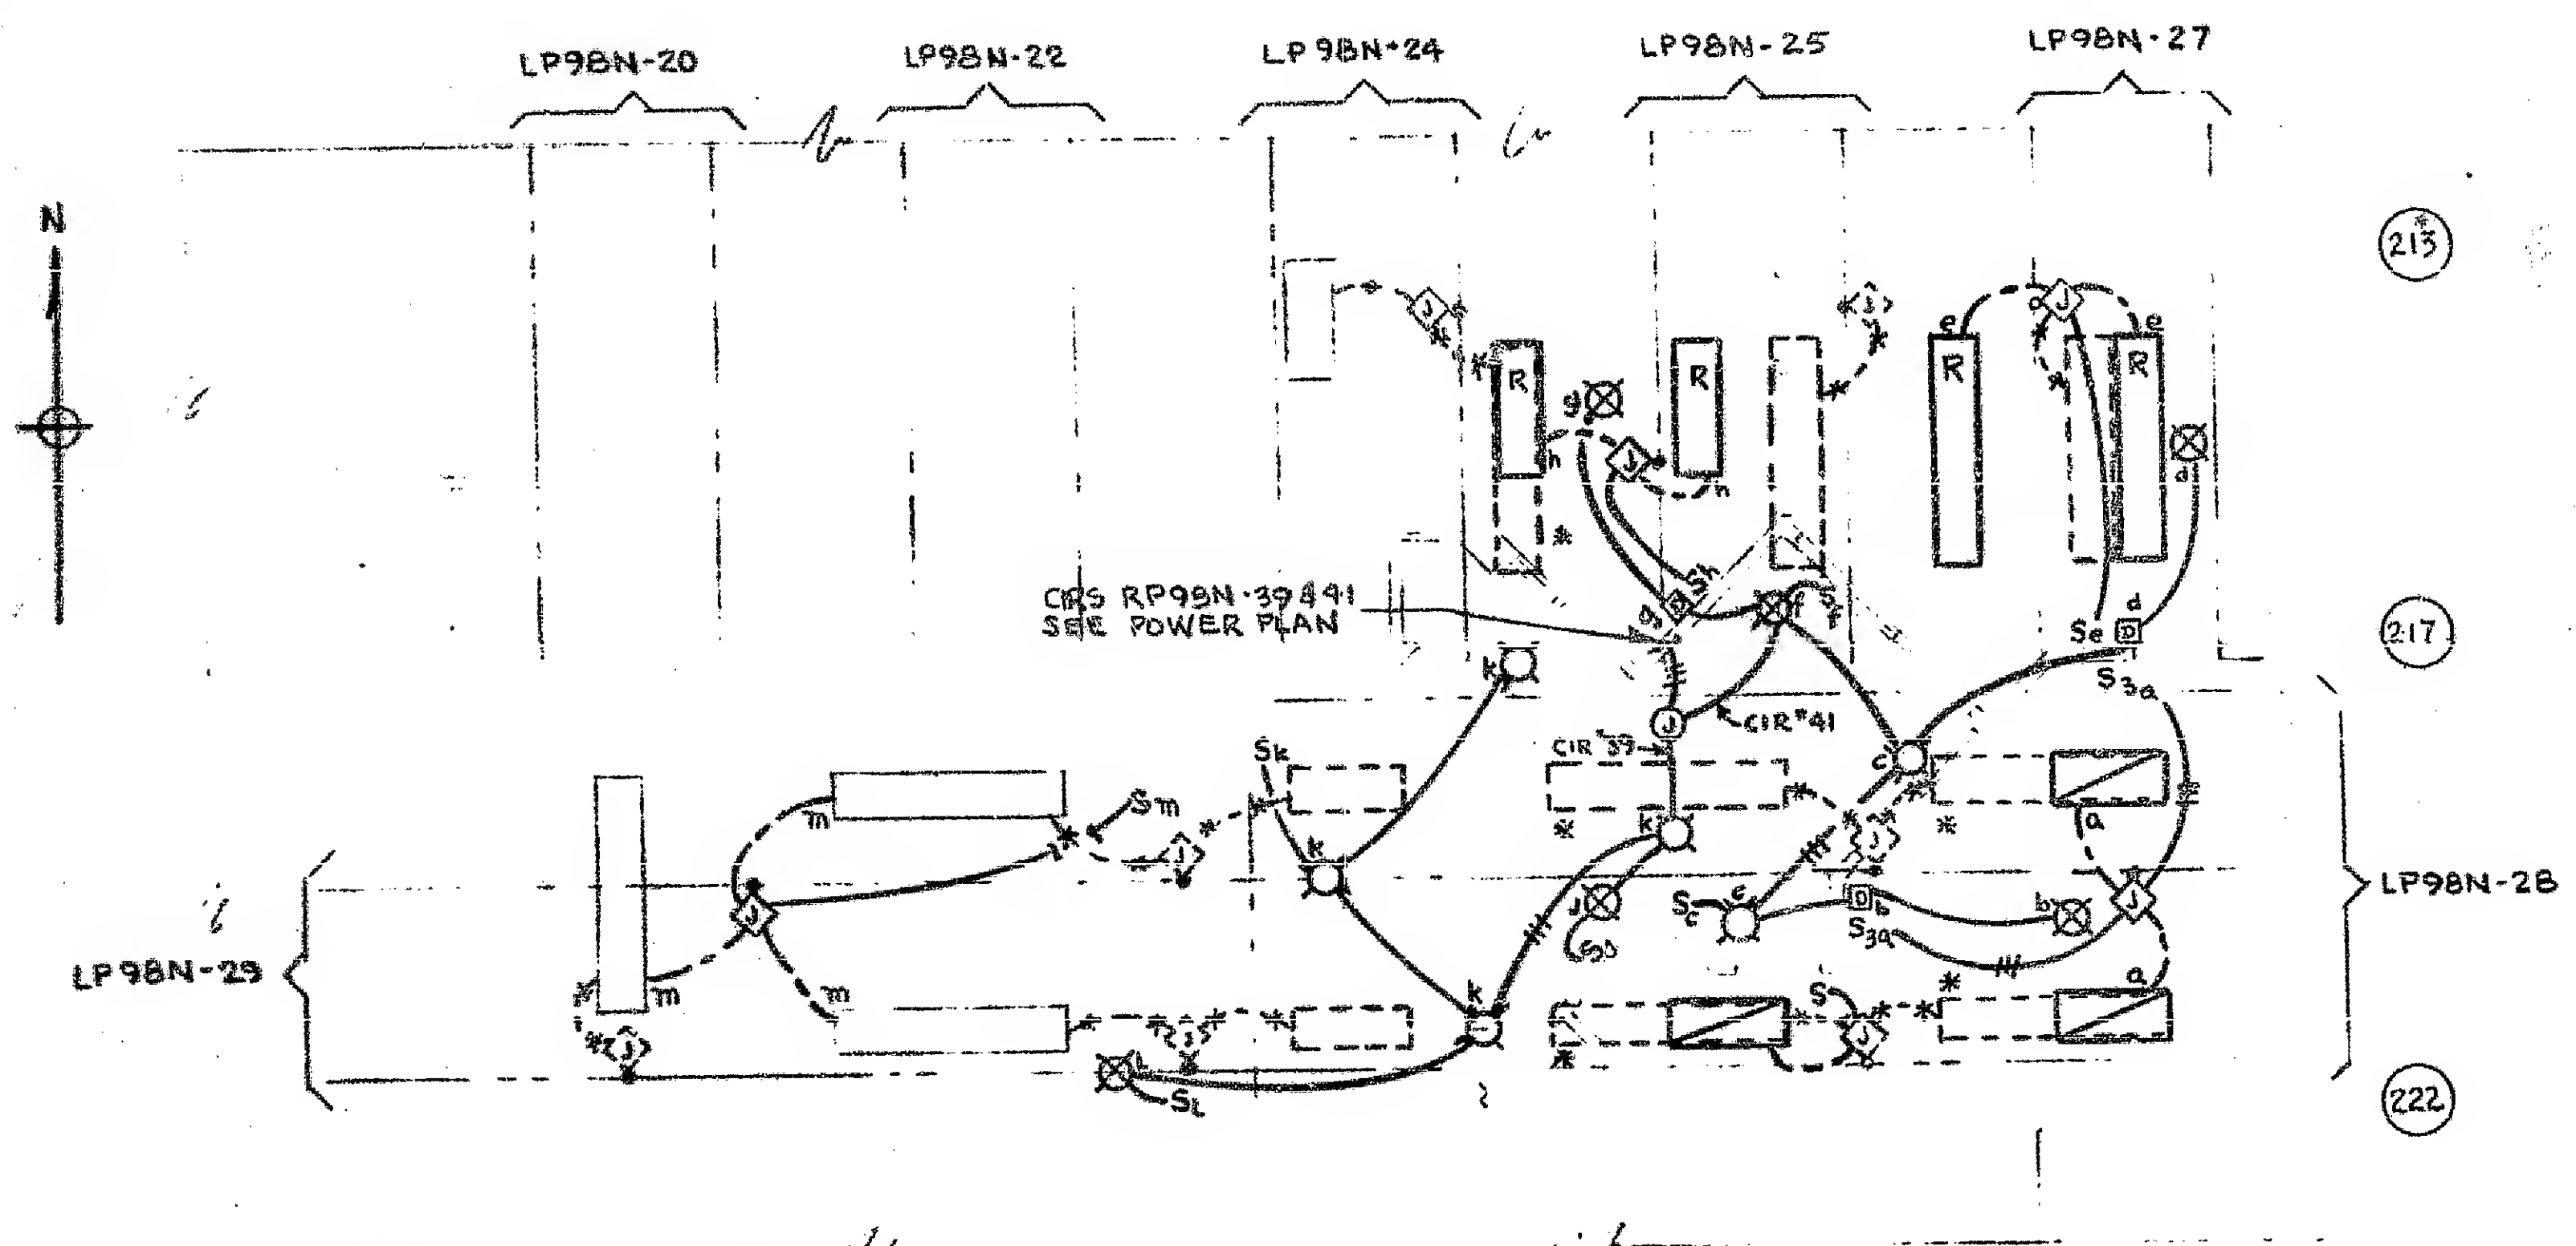

LIGHTING PLAN
SCALE 1/8" = 1'-0"

- LEGEND**
- EXISTING FLUORESCENT LIGHTING FIXTURE (20"x 50") TO BE RELOCATED
 - EXISTING FLUORESCENT LIGHTING FIXTURE TO REMAIN (20"x 100")
 - EXISTING FLUORESCENT LIGHTING FIXTURE (20"x 100") TO BE RELOCATED - ASTERISK DENOTES FIXTURE TO BE REMOVED AND STORED
 - RELOCATED FLUORESCENT LIGHTING FIXTURE (20"x 100")
 - RELOCATED FLUORESCENT LIGHTING FIXTURE (20"x 50")
 - FLUORESCENT LIGHTING FIXTURE (20"x 50"). SUB-LETTER DENOTES SWITCH CONTROL. - SEE NOTE #1.
 - INCANDESCENT SURFACE MOUNTED FIXTURE - 20VOLT-75 WATT
 - INCANDESCENT RECESSED FIXTURE - 120VOLT-75 WATT
 - UNDERCELL MOUNTED BOX ASSEMBLY - SEE NOTE #1.
 - EXISTING UNDERCELL MOUNTED BOX ASSEMBLY TO REMAIN.
 - REMOVE EXISTING UNDERCELL MOUNTED BOX ASSEMBLY, INSTALL SUITABLE FITTING TO CAP OPENING IN EXISTING CEILING WIREWAY.
 - JUNCTION BOX
 - SINGLE POLE WALL SWITCH, MOUNTED 50" A.F.F. UNLESS OTHERWISE NOTED. SUB-LETTER INDICATES FIXTURE(S) CONTROLLED - 20A., 277V., CAT. #112 BY HUBBELL (#1101-GRAY; 15A., 120V.).
 - THREE-WAY WALL SWITCH, MOUNTED 50" A.F.F. UNLESS OTHERWISE NOTED. SUB-LETTER INDICATES FIXTURE(S) CONTROLLED - 20A., 277V., CAT. #112 BY HUBBELL (#1103-GRAY; 15A., 120V.).
 - ROTARY ON-OFF SINGLE POLE 600W-120VOLT DIMMER SWITCH WITH BRUSHED ALUMINUM FACE PLATE - SUB LETTER DENOTES FIXTURE(S) CONTROLLED - LUTRON CAT. #D-600P
 - SMALL FAN STARTER SWITCH WITH OVERLOAD G.E. CAT. #CR-101-Y
 - EXISTING AFTERSET FITTING, COMBINATION TELEPHONE/DUPLEX RECEPTACLE TO REMAIN.
 - REMOVE EXISTING COMBINATION TELEPHONE/DUPLEX RECEPTACLE - SEE NOTE #11. ASTERISK DENOTES FLOOR OUTLET UNIT TO BE RELOCATED
 - RELOCATED COMBINATION TELEPHONE/DUPLEX RECEPTACLE. CORE DRILL FLOOR, INSTALL AFTERSET FITTING, SEE NOTE #1.
 - AFTERSET FITTING AND ADAPTOR ASSEMBLY - SEE NOTE #1. WALL MOUNTED DUPLEX RECEPTACLE, 15A., 125V.; ARROW-HART #6352, FURNISHED AND INSTALLED BY CONTRACTOR. MOUNT 12" AFF
 - AFTERSET FITTING AND ADAPTOR ASSEMBLY FOR 3/4" c. - SEE NOTE #1. TELEPHONE OUTLET, FURNISHED AND INSTALLED BY CONTRACTOR. MOUNT 12"
 - SINGLE RECEPTACLE WALL MOUNTED 125V.-20A. ARROW-HART CAT. #6352, FURNISHED AND INSTALLED BY CONTRACTOR
 - EXISTING FLEXIBLE CONDUIT AND CABLE CONNECTION TO REMAIN, RECONNECTION AS REQUIRED.
 - EXISTING FLEXIBLE CONDUIT AND CABLE CONNECTION TO BE REMOVED.
 - RIGID STEEL CONDUIT, HOT DIPPED GALVANIZED (UL STANDARD #6), RUN CONCEALED IN CEILING AND/OR WALL.
 - FLEXIBLE CONDUIT AND CABLE CONNECTION (UL STANDARD #514).
 - CENTERLINE OF EXISTING FLOOR CELL.
 - EXISTING POWER AND TELEPHONE FLOOR CELL.
 - EXISTING FLOOR ACCESS PANELS OF FLOOR CELLS AND HEADER DUCT.

THIS DRAWING FURNISHED SUBJECT TO CONDITIONS STATED IN "WORKMANSHIP AND MATERIALS" CLAUSE OF SPECIFICATIONS. NO INFORMATION CONTAINED HEREIN MAY BE USED WITHOUT WRITTEN CONSENT OF THE PORT AUTHORITY EXCEPT AS PERMITTED IN SAID CLAUSE. ALL INVENTIONS, IDEAS, DESIGNS AND METHODS HEREIN ARE RESERVED TO THE PORT AUTHORITY.

REVISIONS					
NO.	DATE	APPD.	DESCRIPTION	NO.	DATE

ASST. CHIEF ENGINEER OF DESIGN & RESEARCH
CHIEF ELECTRICAL ENGINEER
DATE 12-23-80